



Pikaohje Windis Oviverhokoneen väyläasetuksia varten:

Verkon oletusasetukset:

DHCP: Passive
 Oletus IP: 192.168.42.10
 Subnet mask: 255.255.255.0
 Gateway: 192.168.42.1
 DNS: 8.8.8.8

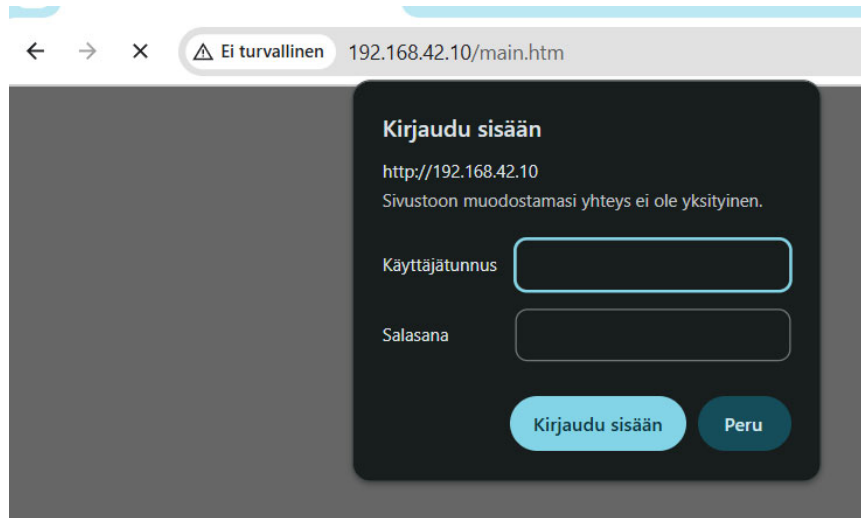

Käyttäjätunnus: ADMIN
 Salasana: SBTAdmin!

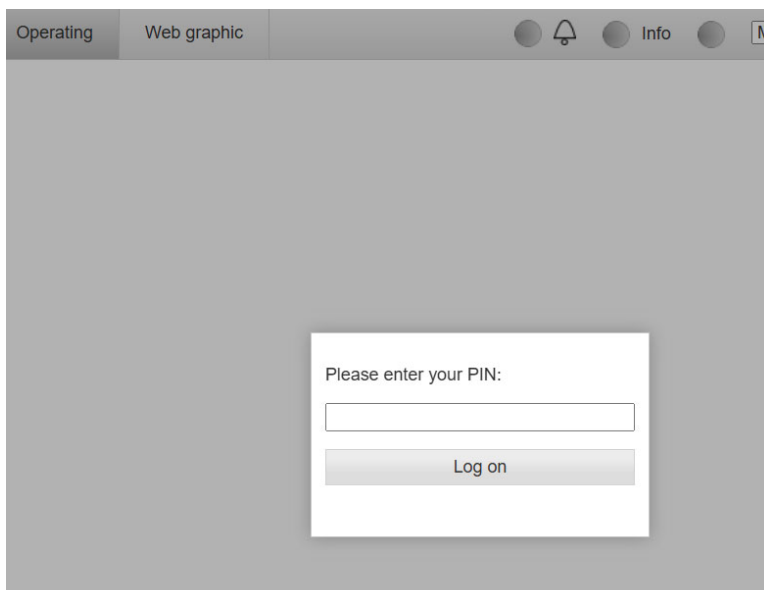

PIN koodi: 6000

Halton

Operating	Web graphic	Info	Metric ▼	English ▼	Log off
-----------	-------------	------	----------	-----------	---------

Halton ▶

Commisioning

Unit settings

Factory Settings

Software Version

Halton

HUOM:
VÄYLÄMUUTOSTEN JÄLKEEN ON MENTÄVÄ "Comis-
sioning" VALIKON LOPPUUN JA SUORITETTAVA RESET
TOIMINTO.

**SÄÄDIN KÄYNNISTYY TÄMÄN JÄLKEEN AUTOMAAT-
TISESTI UUELLEEN**



Operating

Web graphic

Info

Metric ▼

English ▼

Log off

Halton ► Commissioning ►

Instalation height	300.00 cm
Device Role	Master
Number of Devices Connected to Master	3
Address slave unit 1	2
Address slave unit 2	3
Address slave unit 3	4
Day mode setpoint	21.00 °C
Night mode setpoint	19.00 °C
Manual Fan Override	null %
Manual Heating Actuator Override	null %
Temperature Controller:Proportional(P)	3
Temperature Controller:Integral(I)	100s
Temperature Controller:Derative(D)	0s
Post run delay	90s
Room temperature hysteresis	2.00 K
Source of room temperature	Prefer Application
Source of outdoor temperature	Outside Temp.simulation
Outside temp.simulation	5.00°C
Source of Door Switch	Or

Door switch polarity	Reverse
Source of Day/Night mode	Or
Day/Night polarity	Reverse
Source of Run permission	ApI
Run permission polarity	Normal
Fan outlet temperature curve	
FanSpeed Outlet Temperature Curve	
Air curtain position	
System Settings	
Thermokon Out.sensor	No
Winter mode Temp.	15.00 °C
Winter mode hysteresis	2.00 K
DHCP	Passive
IP-Config.	192.168.42.10
Subnet mask	255.255.255.0
Gateway	192.168.42.1
DNS	8.8.8.8
Unit slave address	10
Baudrate	38400
Parity	Even
Stop Bit	One
BACnetBACnet	Active

BACnetPort	47808
BbmdIp	192.168.42.43
BbmdPort	47808
Device ID	1578323
Device Name	POL467.65/STN
BACnet state	OK
Application Save	Passive
Reset	

Halton

Reset

Apply Execute Cancel

Valitse Reset valikosta "Execute" ja paina "Apply"